

Nachweis

Airbourne sound insulation of building elements

Prüfbericht

No. 13-000237-PR01

(PB Z1-A01-04-en-02)



Client **Selectron Elektrokimya San.
ve Tic. Ltd. Sti.
Atatürk Bulvari Köstemir
yolu No:74
34570 Silivri - Istanbul
Türkei**

Basis

EN ISO 10140-1 : 2010
+A1:2012
EN ISO 10140-2 : 2010
EN ISO 717-1 : 1996+A1:2006
13-00237-PR01 (PB Z1-A01-04-de-01) dated 6.3.2013

Representation



Product	Single window, one leaf
System designation	FLAT 68f
External dimension (W x H)	1230 mm x 1480 mm
Material	Aluminium-Softwood
Type of opening	Tilt and Turn
Rebate sealings	1 external, 2 centre, 1 internal
Filling	Insulation glass unit , 4/16/6
Special features	Transport damage at the specimen were repaired

Instructions for use

This test report serves to demonstrate the sound insulation of a building element.

Applicable for Germany

- $R_{w,R}$ as DIN 4109:
(R_w corresponds R_{w,P_1} ,
 $R_{w,R} = R_{w,P} - 2$ dB)
- $R_{w,R}$ for "Bauregelliste"

Validity

The data and results given relate solely to the tested and described specimen.

Testing the acoustic properties does not allow any statement to be made on further characteristics of the present structure regarding performance and quality.

Weighted sound reduction index R_w
Spectrum adaptation terms C and C_{tr}



$$R_w (C; C_{tr}) = 36 (-2;-5) \text{ dB}$$

ift Rosenheim

11.03.2013

Dr. Joachim Hessinger, Dipl.-Phys.
Head of Testing Department
Building Physics

Andreas Preuss, Dipl.-Ing. (FH)
Head of Laboratory
Building Acoustics

Notes on publication

The ift Guidance Sheet "Conditions and Guidance for the use of ift Test Documents" applies.

The cover sheet can be used as abstract.

Contents

This test report contains a total of 9 pages

- 1 Object
 - 2 Procedure
 - 3 Detailed results
 - 4 Instructions for use
- Data sheet (1 page)

Test report 13-000237-PR01 (PB Z1-A01-04-en-02) dated 11. März 2013
Client Selectron Elektrokimya San.
ve Tic. Ltd. Sti., 34570 Silivri - Istanbul (Türkei)



1 Object

1.1 Description of test specimen

Product	Single window, one leaf
Product designation	FLAT 68f
Type of opening	Tilt and Turn
Opening direction	towards receiving room
Mass of windows	65.1 kg
Area related mass	35.7 kg/m ²
Frame member	
Frame member size (W x H)	1230 mm x 1480 mm
Material	Aluminium-Softwood
Profile number	Uniform LA 746 / wood, further details are given in drawings
Profile section (W x D)	90 mm x 83 mm
Casement member	
Casement member size (W x H)	1142 mm x 1397 mm
Material	Aluminium-Softwood
Profile number	Uniform LA860, LC 81 / further details are given in drawings
Profile section (W x D)	80 mm x 99 mm
Rebate configuration	
Rebate drainage	2 x 3 holes, Ø 5mm downward, 4 slots in outer shell downward, 50 mm x 5 mm
Rebate sealing	1 external, 2 centre, 1 internal
External (Type / Material / manufacturer)	EPDM, Uniform DE 115
Position	on aluminium cover profile, mitred
Centre (Type / Material / manufacturer)	EPDM, Uniform DE 126
Position	on frame, continuous, notched in corners, at top centre butt-jointed
Centre (Type / Material / manufacturer)	Polypropylen, Schlegel Q-LON 3054
Position	on casement, continuous, notched in corners, at top centre butt-jointed
Internal (Type / Material / manufacturer)	Polyurethan, Schlegel Q-LON 3053
Position	on casement, continuous, notched in corners, at top centre butt-jointed
Pressure equalisation	without pressure equalisation.
Filling	Insulation glass unit
Type, manufacturer	Sağlam Cam Tic. San. Ltd. Şti.
Visible size (W x H)	985 mm x 1240 mm

Test report 13-000237-PR01 (PB Z1-A01-04-en-02) dated 11. März 2013
Client Selectron Elektrokimya San.
ve Tic. Ltd. Sti., 34570 Silivri - Istanbul (Türkei)

Total thickness in the edge	26 mm
Total thickness in the middle	27 mm
Construction	4/16/6
Gas filling in cavity	according to manufacturer
Type of Gas	Argon
Filling	90 %

Mounting of filling

Sealing system	Seal profiles internal and external
Inside: Type/Material/Manufacturer	EPDM, Uniform DE 133
Outside: Type/Material/Manufacturer	EPDM, Uniform DE 115
Vapour pressure equalization	3 mm continuous opened

Fittings

Type, Manufacturer	MACO
Hinges/pivots	1 tilt mechanism pivot, 1 corner pivot
Lockings	at bottom 2, at top 2, on hinge side 2, on lock side 3
Closing force	< 10 Nm

The description is based on inspection of the test specimen at ift laboratory building acoustic. Article designations / numbers as well as material specifications were given by the client.

1.2 Mounting in test rig

Test rig	Window test rig „Z“ with suppressed flanking transmission acc. to EN ISO 10140-5: 2010; the test rig includes a mounting frame with a continuous acoustic break which is sealed in the test opening with elastic sealant.
Mounting of test specimen	Test specimen mounted by ift Laboratory for Building Acoustics
Mounting conditions	Mounting in test opening, connecting joints stuffed with foam and sealed on both sides with plastic sealant.
Mounting position	At the rate of 1/3 to 2/3 in the test opening.
Opening direction	Towards receiving room.
Preparation	The window was opened and closed repeatedly.

1.3 Representation of test specimen

The structural details were examined solely on the basis of the characteristics to be classified. The illustrations are based on unchanged documentation provided by the client.

Test report 13-000237-PR01 (PB Z1-A01-04-en-02) dated 11. März 2013

Client Selectron Elektrokimya San.
ve Tic. Ltd. Sti., 34570 Silivri - Istanbul (Türkei)



fig 1 Photos of the mounted element, taken by **ift** Laboratory for Building Acoustics

Test report 13-000237-PR01 (PB Z1-A01-04-en-02) dated 11. März 2013

Client Selectron Elektrokimya San. ve Tic. Ltd. Sti., 34570 Silivri - Istanbul (Türkei)

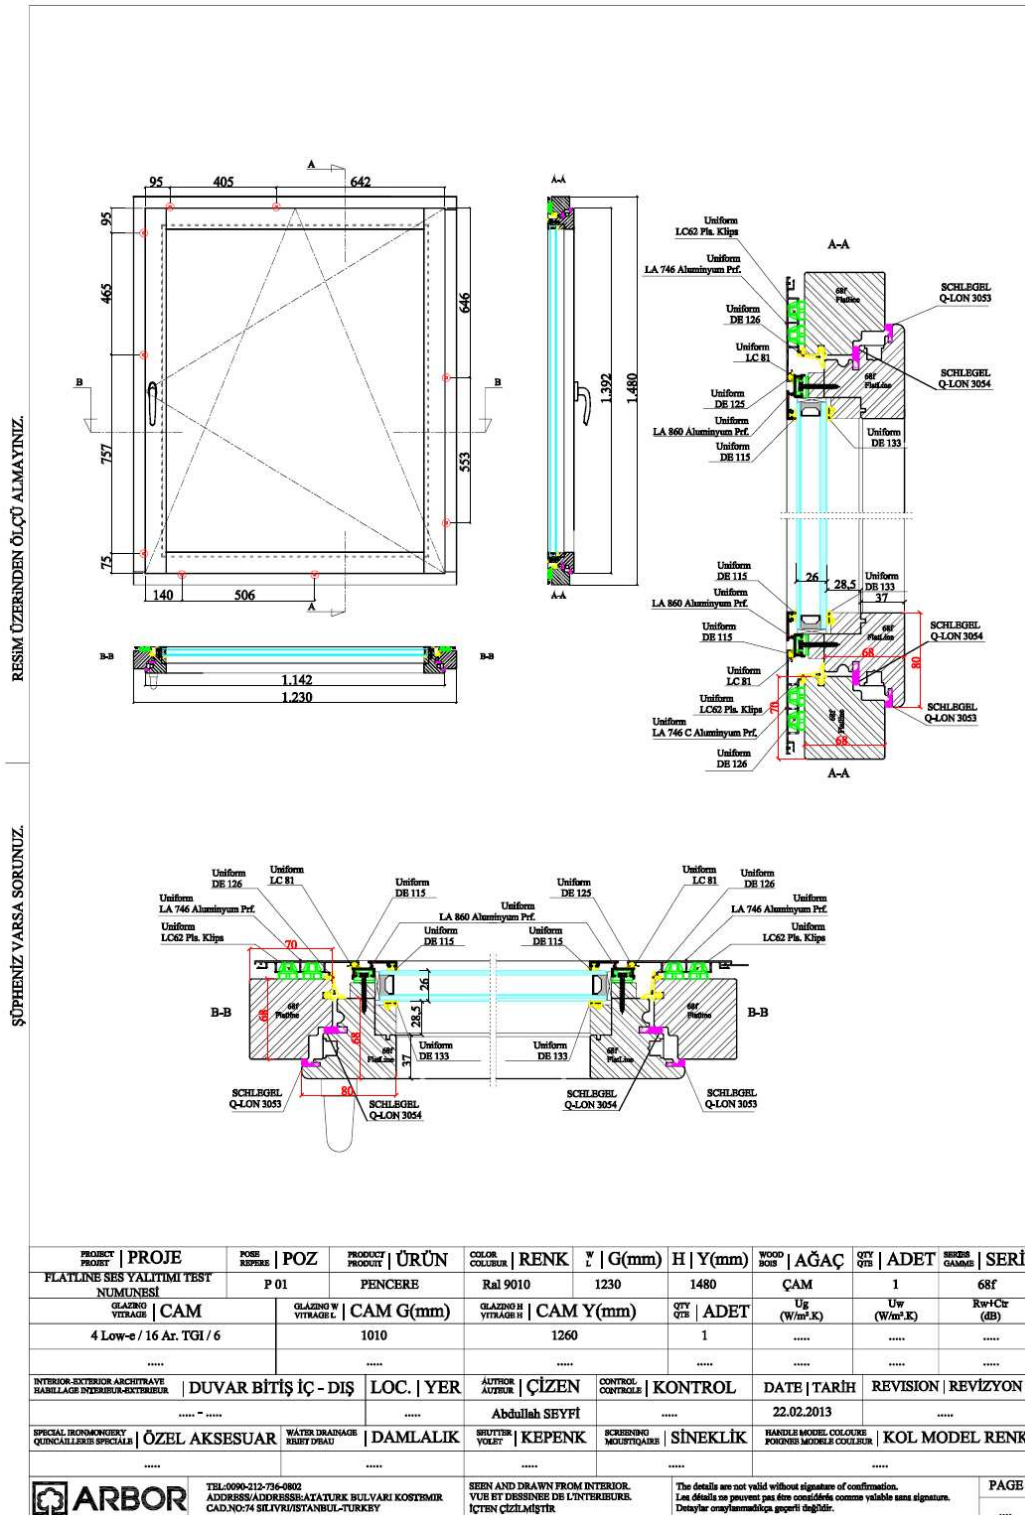


fig 2

view, vertical cross section, horizontal section

Test report 13-000237-PR01 (PB Z1-A01-04-en-02) dated 11. März 2013
Client Selectron Elektrokimya San.
ve Tic. Ltd. Sti., 34570 Silivri - Istanbul (Türkei)



2 Procedure

2.1 Sampling

Sampling	The samples were selected by the client
Quantity	1
Manufacturer	Selectron Elektrokimya San.Ve tic. Ltd Őti (Arbor Wood Windows)
Date of manufacture	22. February 2013
Production line	
Responsible for sampling	Mr. Seyfi, Abdullah
Delivery at ift	Delivery at ift 26. February 2013 by the client via forwarding agency
ift registration number	34166/1

2.2 Process

Basis

- EN ISO 10140-1:2010 + A1 : 2012 Acoustics; Laboratory measurement of sound insulation of building elements - Part 1: Application rules for specific products (ISO 10140-1:2010+Amd.1:2012)
- EN ISO 10140-2:2010 Acoustics; Laboratory measurement of sound insulation of building elements - Part 2: Measurement of airborne sound insulation (ISO 10140-2:2010)
- EN ISO 717-1: 1996 + A1:2006 Acoustics; Rating of sound insulation in buildings and of building elements - Part 1: Airborne sound insulation

Corresponds to national German standard:

DIN EN ISO 10140-1:2012-05, DIN EN ISO 10140-2:2010-12 und DIN EN ISO 717-1 : 2006-11

The processing and volume of the test is according to the principles of the "Arbeitskreis der bauaufsichtlich anerkannten Schallprüfstellen" in agreement with NA 005-55-75-AA (UA 1 to DIN 4109).

Boundary conditions	As required in the standard.
Deviation	There are no deviations from the test procedure and/or test conditions.
Test noise	Pink noise
Measuring filter	One-third-octave band filter
Measurement limits	
Low frequencies	The dimensions of the receiving room were smaller than recommended for testing in the frequency range from 50 Hz to 80 Hz as per EN ISO 10140-4:2010 Annex A (informative). A moving loudspeaker was used.

Test report 13-000237-PR01 (PB Z1-A01-04-en-02) dated 11. März 2013
Client Selectron Elektrokimya San. ve Tic. Ltd. Sti., 34570 Silivri - Istanbul (Türkei)



Background noise level	The background noise level in the receiving room was determined during measurement and the receiving room level L_2 corrected by calculation as per EN 10140-4: 2010 Clause 4.3.
Maximum sound insulation	The Maximum sound insulation of the test rig is at least 15 dB higher than the measured sound reduction index of the test specimen. Not corrected by calculation.
Measurement of reverberation time	arithmetical mean: two measurements each of 2 loudspeaker and 3 microphone positions (total of 12 independent measurements).
Measurement equation A	$A = 0,16 \cdot \frac{V}{T} \text{ m}^2$
Measurement of sound level difference	Minimum of 2 loudspeaker positions and rotating microphones.
Measurement equation	$R = L_1 - L_2 + 10 \cdot \lg \frac{S}{A} \text{ dB}$

LEGEND

A	equivalent absorption area in m^2
L_1	Sound pressure level source room in dB
L_2	Sound pressure level receiving room in dB
R	Sound reduction index in dB
T	Reverberation time in s
V	Volume of receiving room in m^3
S	Testing area of the specimen in m^2

2.3 Test equipment

Device	Type	Manufacturer
Integrating sound meter	Type Nortronic 840	Norsonic-Tippkemper
Microphone preamplifiers	Type 1201	Norsonic-Tippkemper
Microphone units	Type 1220	Norsonic-Tippkemper
Calibrator	Type 1251	Norsonic-Tippkemper
Dodecahedron loudspeakers	Own production	-
Amplifier	Type E120	FG Elektronik
Rotating microphone boom	Own production / Type 231-N-360	Norsonic-Tippkemper

The **ift** Laboratory for Building Acoustics participates in comparative measurements at the Physikalisch-Technische Bundesanstalt (PTB) in Braunschweig every three years, the last one was in April 2010. The sound level meter used, Series N. 17848, was calibrated by the Dortmund Eichamt (calibration agency) on 19. January 2012. The calibration is valid until 31. December 2014.

Test report 13-000237-PR01 (PB Z1-A01-04-en-02) dated 11. März 2013
Client Selectron Elektrokimya San.
ve Tic. Ltd. Sti., 34570 Silivri - Istanbul (Türkei)

2.4 Testing

Date 1. March 2013
Test engineer Andreas Preuss

3 Detailed results

The values of the measured sound reduction index of the tested window are plotted as a function of frequency in the annexed data sheet and tabled.

As per EN ISO 717-1 the weighted sound reduction index R_w and the spectrum adaptation terms C and C_{tr} for the frequency range 100 Hz to 3150 Hz obtained by calculation are as follows:

$$R_w (C;C_{tr}) = 36 (-2;-5) \text{ dB}$$

According to EN ISO 717-1 the following additional spectrum adaptation terms are obtained

$C_{50-3150} = -2 \text{ dB}$	$C_{100-5000} = -1 \text{ dB}$	$C_{50-5000} = -1 \text{ dB}$
$C_{tr,50-3150} = -6 \text{ dB}$	$C_{tr,100-5000} = -5 \text{ dB}$	$C_{tr,50-5000} = -6 \text{ dB}$

4 Instruction for use

4.1 Safety margin according to DIN 4109

Basis
DIN 4109:1989-11 Sound insulation in buildings, requirements and verifications

For verification of sound insulation according to DIN 4109: 1989-11 (Suitability Test I) the weighted sound reduction index R_w corresponds to the test value $R_{w,P}$. Including safety margin of 2 dB, the following value $R_{w,R}$ is obtained by calculation

$$R_{w,R} = 34 \text{ dB}$$

4.2 Test standards

The standard series EN ISO 10140:2010 supersedes those, until the respective date, applicable parts of the standards series EN ISO 140 which describe laboratory tests. According to the two standard series, the test methods are identical.

ift Rosenheim
Laboratory for Building Acoustics
11. März 2013

Sound reduction index according to ISO 10140 - 2

Laboratory measurements of airborne sound insulation of building elements



Client: Selectron Elektrokimya San. ve Tic. Ltd. Sti., 34570 Silivri - Istanbul (Türkei)

Product designation FLAT 68f

Design of test specimen

Single window, one leaf

External dimension 1230 mm x 1480 mm

Material Aluminium-Softwood

Type of opening Tilt and Turn

Rebate seals 1 external, 2 centre, 1 internal

Lockings at bottom 2, at top 2, on hinge side 2, on lock side 3

Infill panel Insulation glass unit

Pane configuration 4/16/6

Gas filling in cavity Argon

Test date 1. March 2013

Test surface S 1.25 m x 1.50 m = 1.88 m²

Test rig as per EN ISO 10140-5

Partition wall Double-leaf concrete wall, insert frame

Test noise pink noise

Volumes of test rooms V_S = 104.0 m³
V_E = 67.5 m³

Maximum sound reduction index R_{w,max} = 62 dB (related to test surface)


Mounting conditions

Window butt-mounted in test opening. Connecting joints filled with foam and sealed with plastic sealant on both sides

Climate in test rooms 20 °C / 30 % RF

Static air pressure 960 hPa

f in Hz	R in dB
50	30.6
63	26.0
80	24.7
100	21.5
125	20.4
160	19.6
200	19.9
250	26.9
315	30.8
400	33.0
500	34.6
630	37.4
800	37.3
1000	37.3
1250	39.0
1600	40.7
2000	38.8
2500	35.9
3150	34.2
4000	40.8
5000	48.7

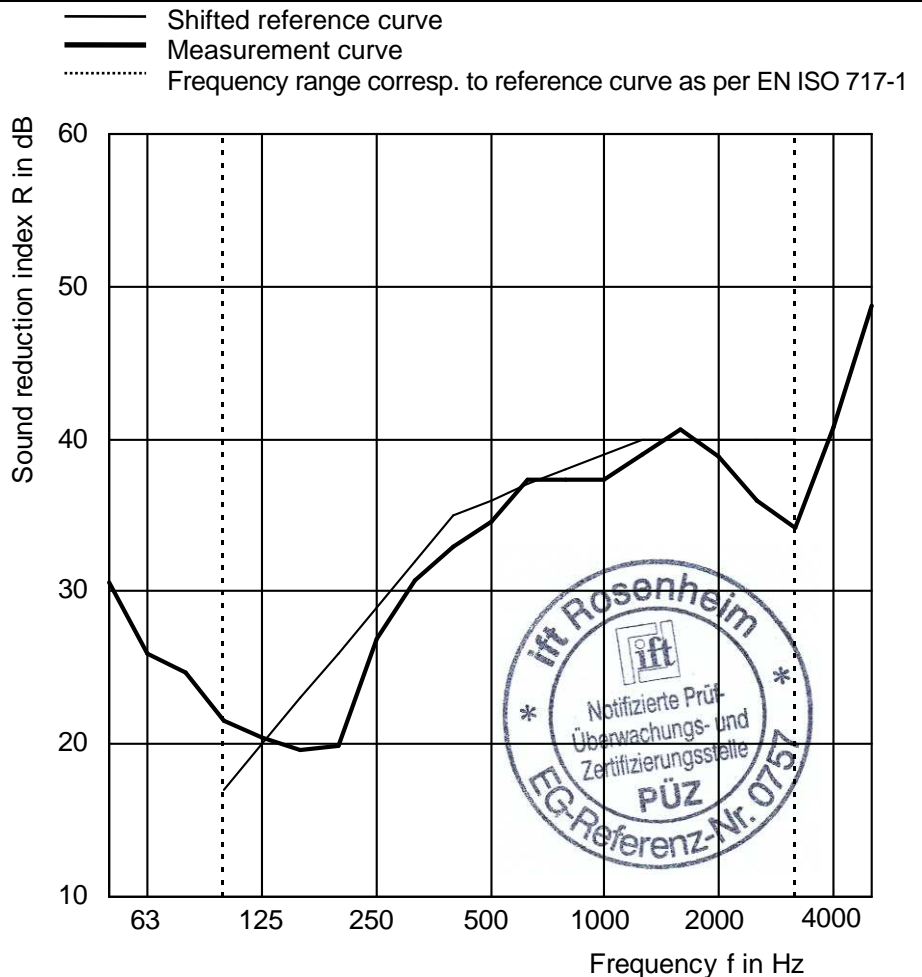

Rating according to EN ISO 717-1 (in third octave bands):

R_w (C;C_{tr}) = **36 (-2;-5) dB**

C₅₀₋₃₁₅₀ = -2 dB; C₁₀₀₋₅₀₀₀ = -1 dB; C₅₀₋₅₀₀₀ = -1 dB

C_{tr.50-3150} = -6 dB; C_{tr.100-5000} = -5 dB; C_{tr.50-5000} = -6 dB

Test report No.: 13-000237-PR01 (PB Z1-A01-04-en-02)

Page 9 of 9. Data sheet No. Z1

ift Rosenheim

Laboratory for Building Acoustics

11. März 2013

Dipl. Ing. (FH) Andreas Preuss

Head of Laboratory